



Installation Instructions

Instructions d'installation
Installationsanweisungen
Instrucciones de instalación
Istruzioni per l'installazione
Installatie-instructies
インストール手順
安装指示
إرشادات التركيب

⚡ Devices must be installed in an approved enclosure by a qualified electrician in accordance with all national and local electrical and construction codes and regulations.

Les appareils doivent être installés dans un lieu jugé apte, par un électricien qualifié et conformément aux règles et normes locales et nationales en matière d'électricité et de construction.

Die Geräte müssen von einem geprüften Elektriker entsprechend allen nationalen und lokalen Elektro – und Bauvorschriften in einem zugelassenen Gehäuse installiert werden.

Los dispositivos se deben instalar en un recinto aprobado por un electricista cualificado de acuerdo a todos los reglamentos eléctricos y de construcción locales y nacionales pertinentes





I dispositivi devono essere installati da un elettricista qualificato in un luogo approvato, in conformità a tutti gli standard e le norme nazionali e locali vigenti in materia di impianti elettrici e costruzioni edilizie.

Apparaten moeten door een erkende elektricien worden geïnstalleerd in een goedgekeurde behuizing in overeenstemming met alle nationale en lokale elektriciteits – en bouwvoorschriften en wetgeving.

デバイスを取り付ける際は、資格のある電気技師に依頼し、電気と建設に関する国および地域のすべての法令に従って、認可されている筐体内に取り付けてください。

根据国家/地区及当地的电气与建筑规范和法规，该设备必须由有资质的电工安装在经批准的外罩内。

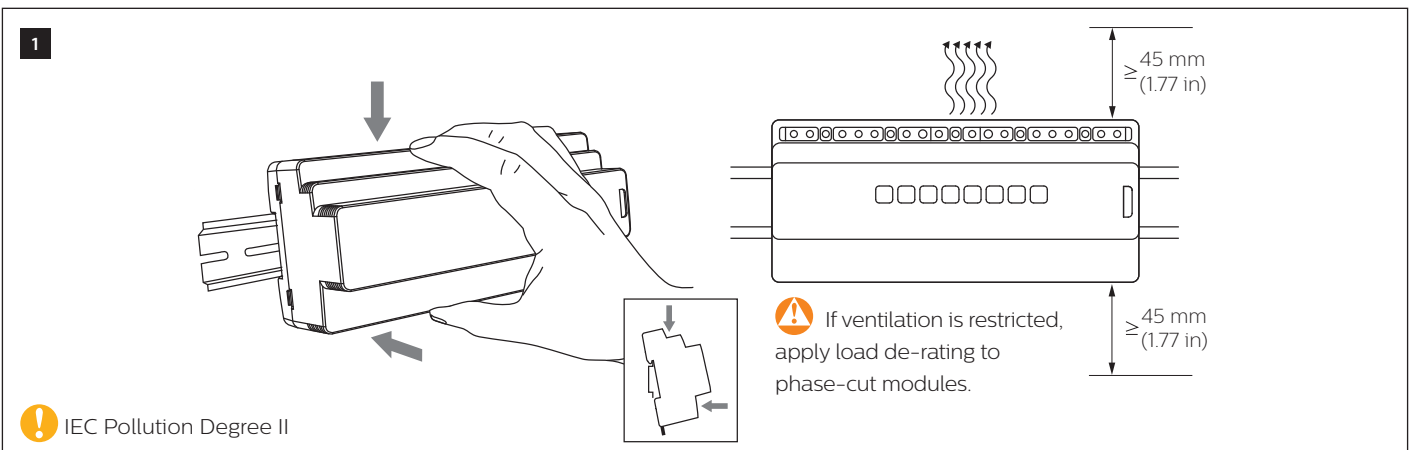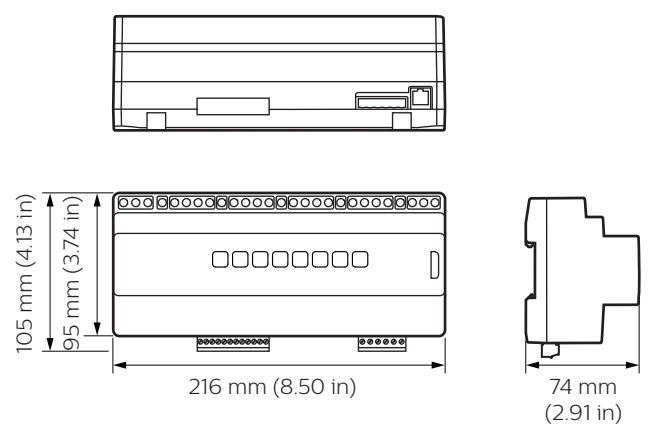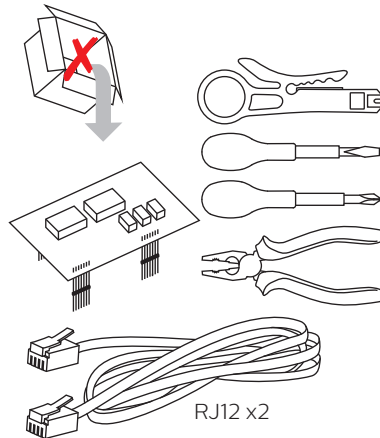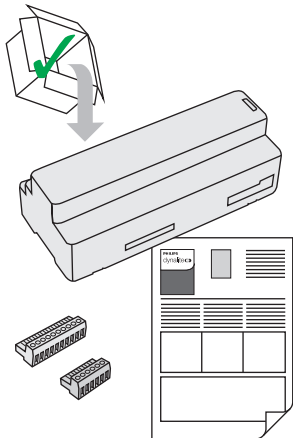

يلزم تركيب الأجهزة داخل حاوية معتمدة، من قبل كهربائي مؤهل وفقاً لجميع قوانين ولوائح الكهرباء والإنشاءات الوطنية والمحلية




! IEC Pollution Degree II




2

≤ 5 A/CH




≤ 16 A




DDMC802



Specification sheet
Fiche technique
Datenblatt
Hoja de especificaciones
Foglio di specifiche
Technische fiche
仕様書シート
規格表
ورقة المواصفات













≤ 5 mm²
10+ AWG

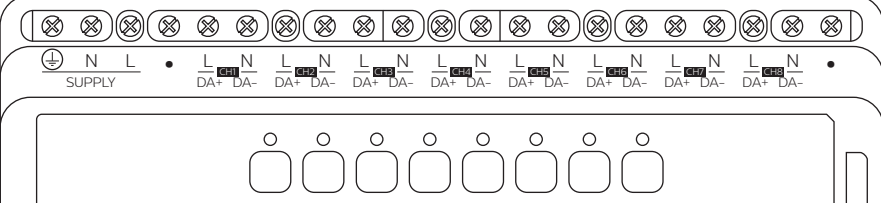
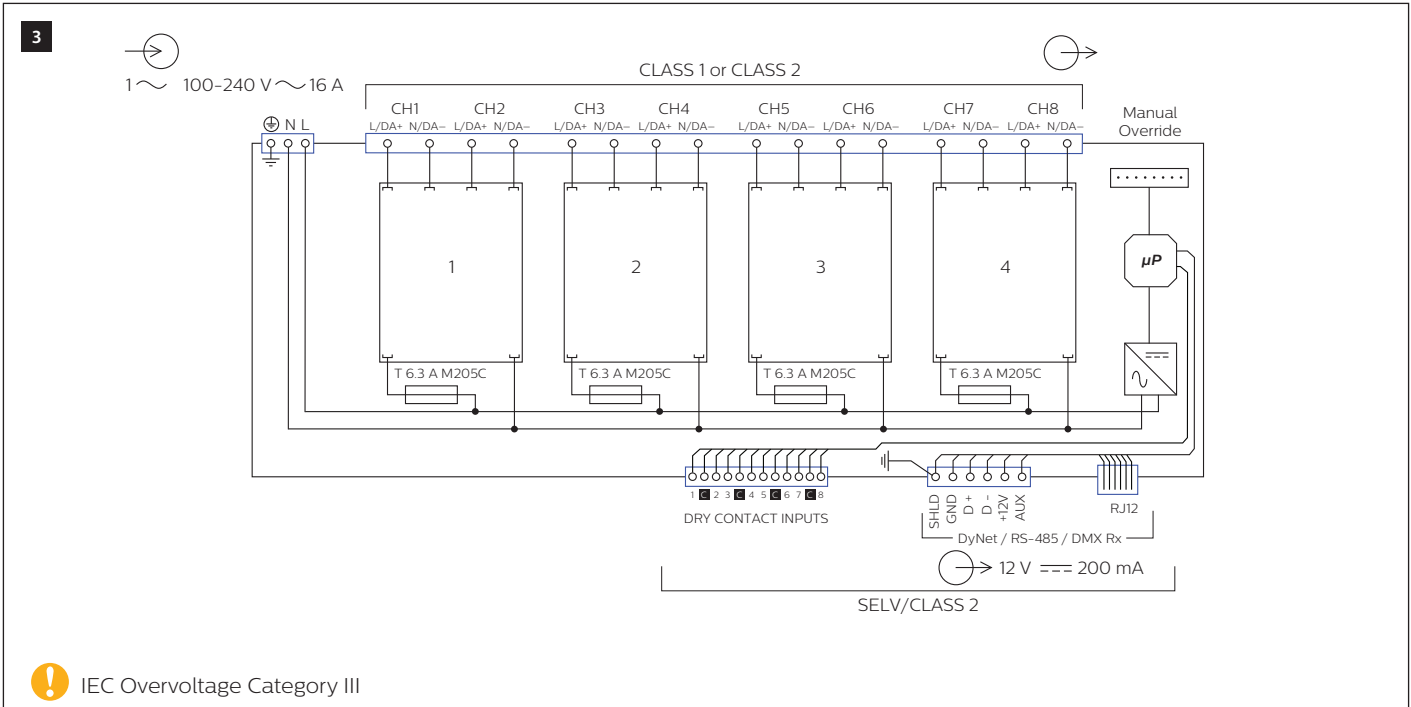


0.6 Nm
5.5 Lb-in

4

<p>DGCM102</p>  <p>1 x 2 A curtain module</p>	<p>DGFM102</p>  <p>1 x 2 A fan module</p>	<p>DGRM204</p>  <p>2 x 4 A relay module</p>
<p>DGBM200</p>  <p>2 CH ballast module</p>	<p>DGTM104</p>  <p>1 x 4 A Trailing Edge dimmer module</p>	<p>DGLM202</p>  <p>2 x 2 A Leading Edge dimmer module</p>
<p>DGTM202</p>  <p>2 x 2 A Trailing Edge dimmer module</p>	<p>DGLM105</p>  <p>1 x 5 A Leading Edge dimmer module</p>	<p>DGLM402</p>  <p>4 x 2 A Leading Edge dimmer module</p>
<p>DGTM402</p>  <p>4 x 2 A Trailing Edge dimmer module</p>		

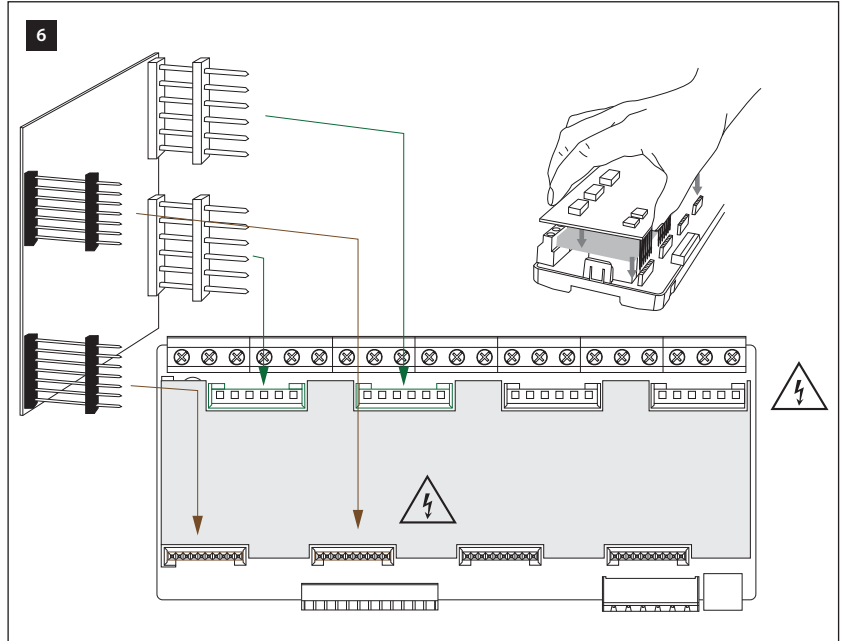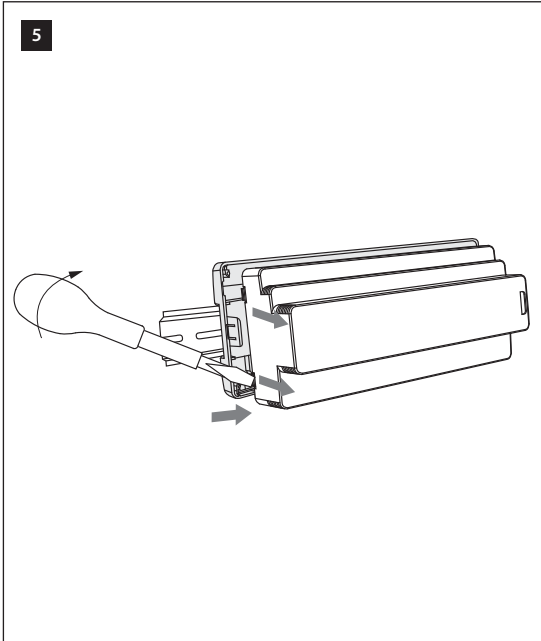

7 A

DGCM102
1 x 2 A
curtain
module

Load type	Output ratings per channel
General use	2 A, 230 V ~
Motor x 1	4.4 FLA (1/6 HP), 120 V ~
	4.9 FLA (1/2 HP), 230 V ~

7 B

DGFM102
1 x 2 A
fan
module



Load type	Output ratings per channel
Motor x 1	400 VA, 230 V ~

Not suitable for 120 VAC ~ (Not UL listed)

7 C




DGRM204
2 x 4 A
relay module

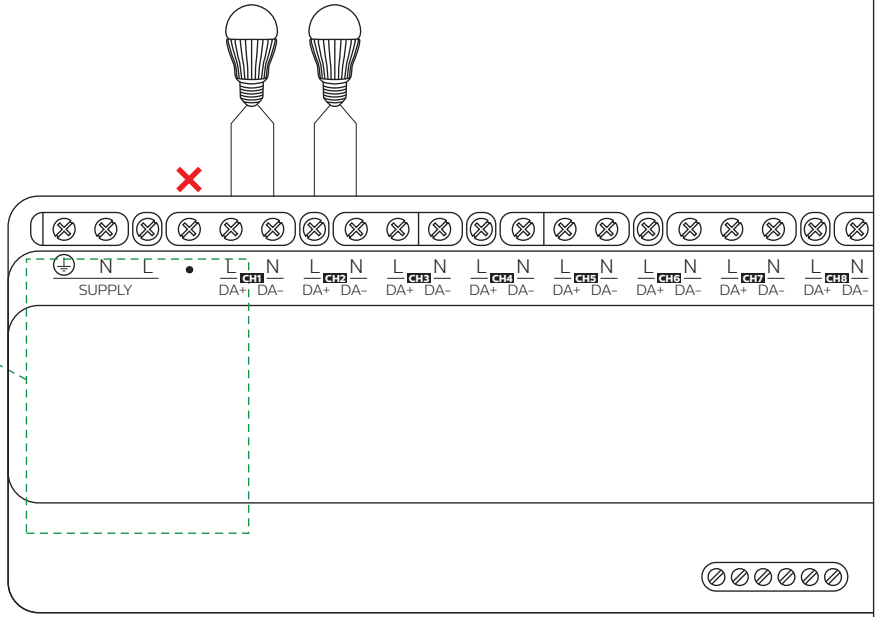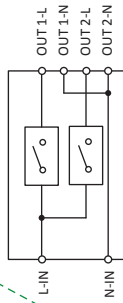


Load type	Output ratings per channel
General Use	4 A, 230 V ~
Incandescent	600 W, 120 V ~ 1100 W, 230 V ~
Standard ballast	2 A, 120 V ~
Electronic ballast	4 A, 120 V ~ 3 A, 230 V ~

Module Load ≤ 5 A




7 D



DGBM200
2 CH
ballast module



Protocol

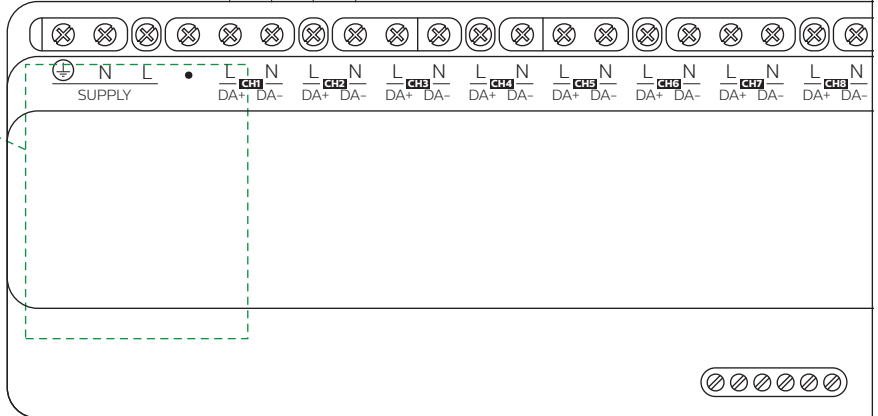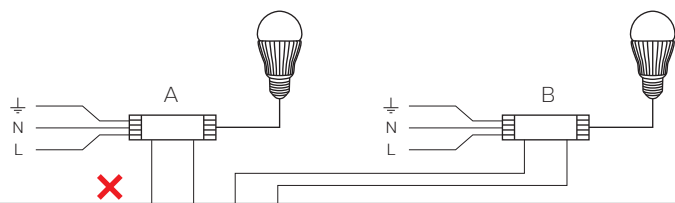
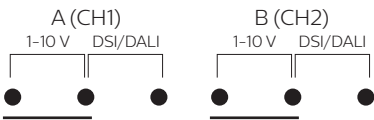


Load type	Max ballasts	Output ratings per channel
1-10 V	10	10 mA sink/source
DSI/DALI	5	13 V = 10 mA guaranteed, 250 mA max. DALI Insulation System: Basic Supporting Class 1 / Class 2 wiring

7 E



DGTM104
1 x 4 A
TE dimmer
module

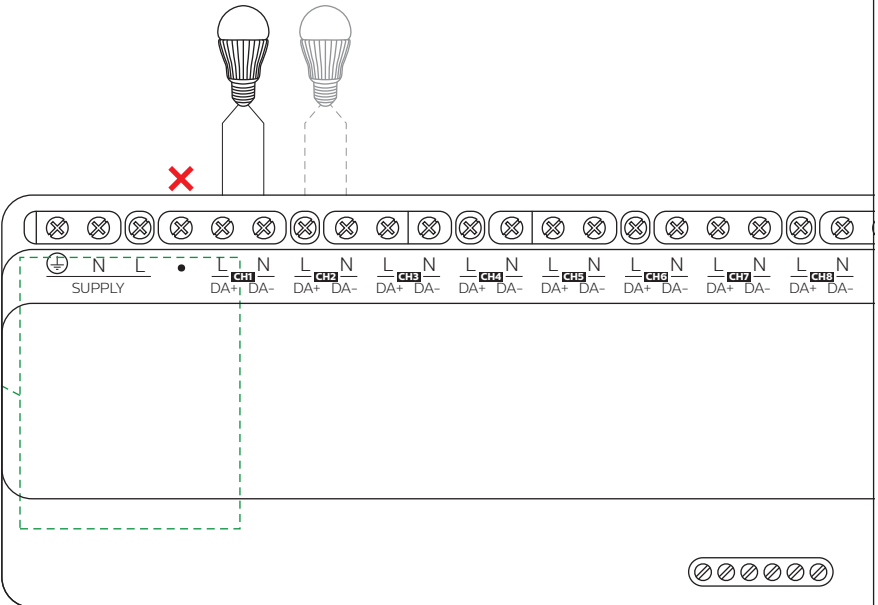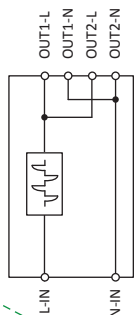



Load type	Output ratings per channel
Incandescent	4 A, 120-230 V ~
Electronic ballast	4 A, 120-230 V ~

Not compatible with magnetic transformers.

7 F



DGLM202
2 x 2 A
LE dimmer module

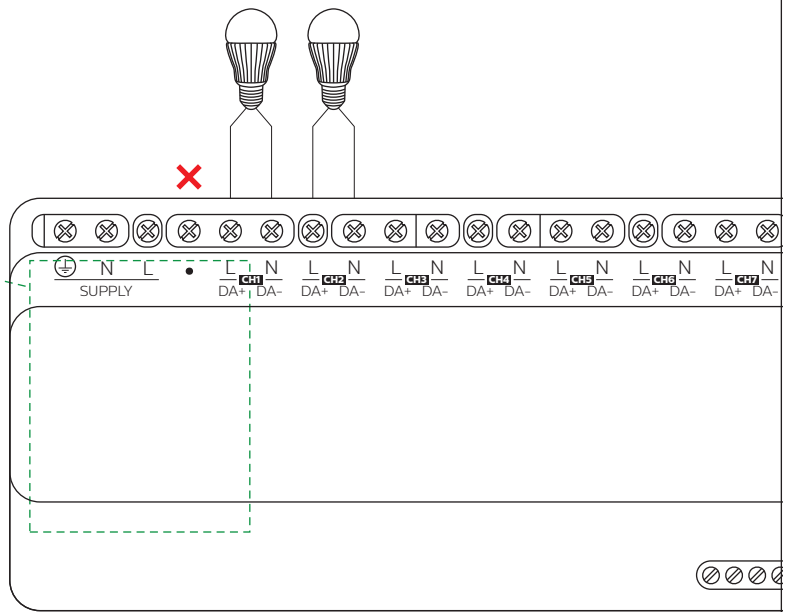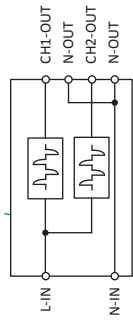



Load type	Output ratings per channel
Incandescent	2 A, 120-230 V ~
Standard ballast	2 A, 120-230 V ~
Electronic ballast*	2 A, 120-230 V ~

*can be limited by load capacitance.

7 G




DGTM202
2 x 2 A
TE dimmer module

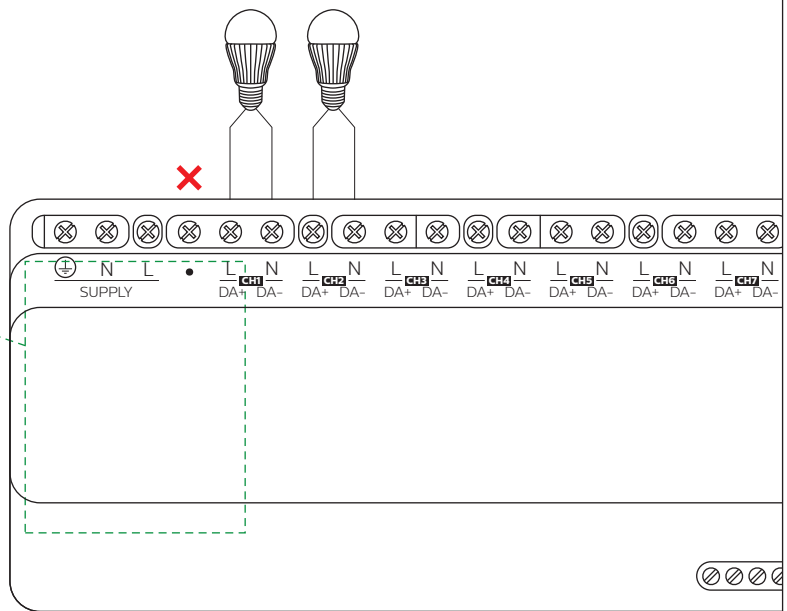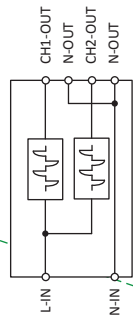



Load type	Output ratings per channel
Incandescent	2 A, 120-230 V ~
Electronic ballast	2 A, 120-230 V ~

Not compatible with magnetic transformers.

7 H



DGLM105
1 x 5 A
LE dimmer module

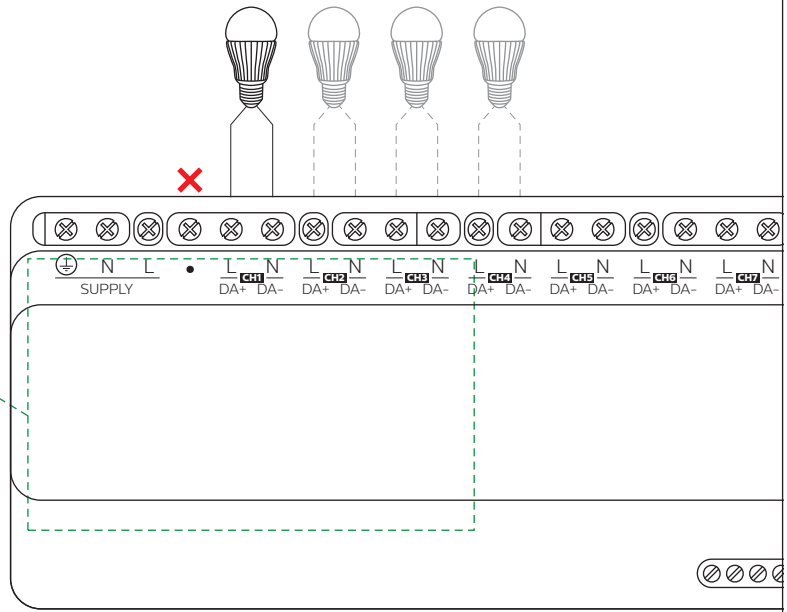



Load type	Output ratings per channel
Incandescent	5 A, 120-230 V ~
Standard ballast	5 A, 120-230 V ~
Electronic ballast*	5 A, 120-230 V ~

*can be limited by load capacitance

7 I



DGLM402
4 x 2 A
LE dimmer
module

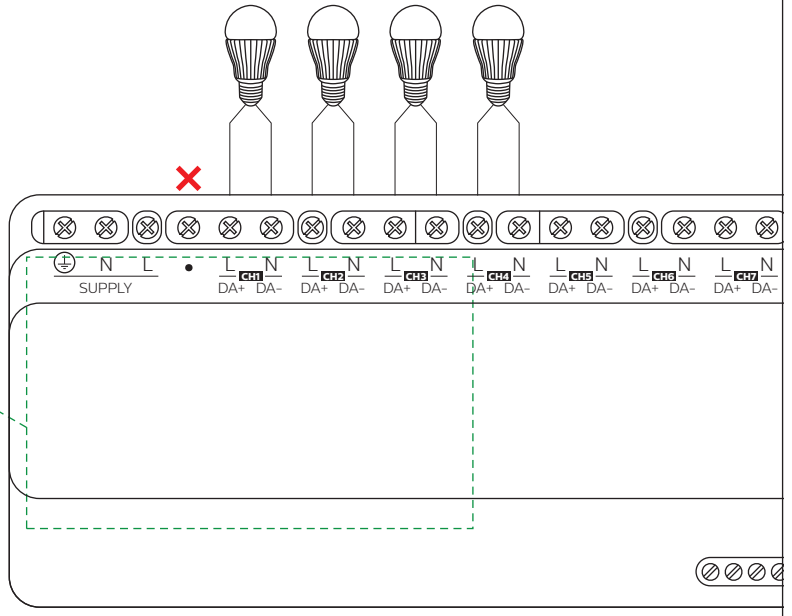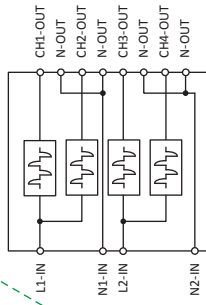


Load type	Output ratings per channel
Incandescent	2 A, 120-230 V ~
Standard ballast	2 A, 120-230 V ~
Electronic ballast*	2 A, 120-230 V ~



Module Load ≤ 5 A

*can be limited by load capacitance

7 J



DGTM402
4 x 2 A
TE dimmer
module

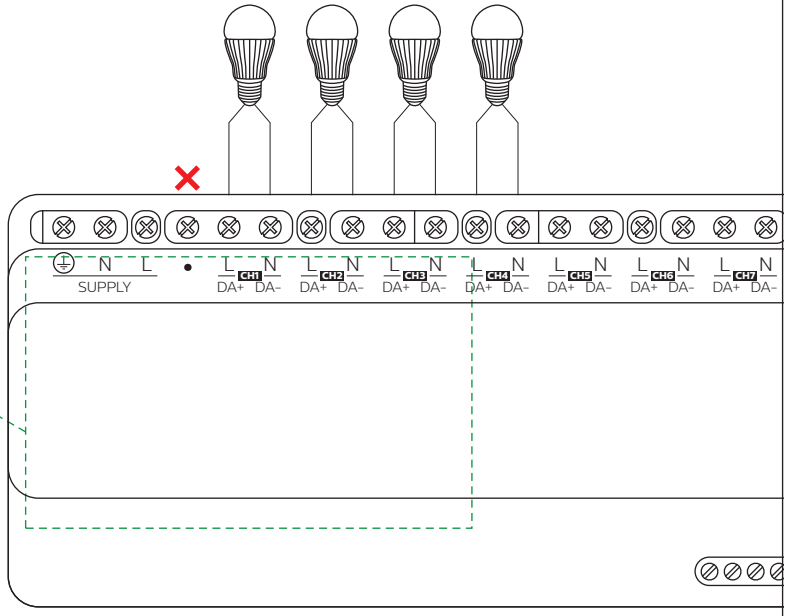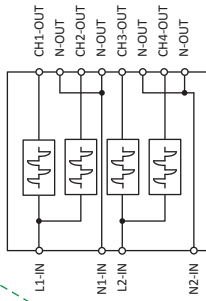


Load type	Output ratings per channel
Incandescent	2 A, 120-230 V ~
Electronic ballast	2 A, 120-230 V ~


Module Load ≤ 5 A





Not compatible with magnetic transformers.




8

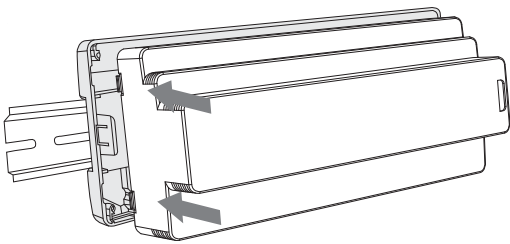

9

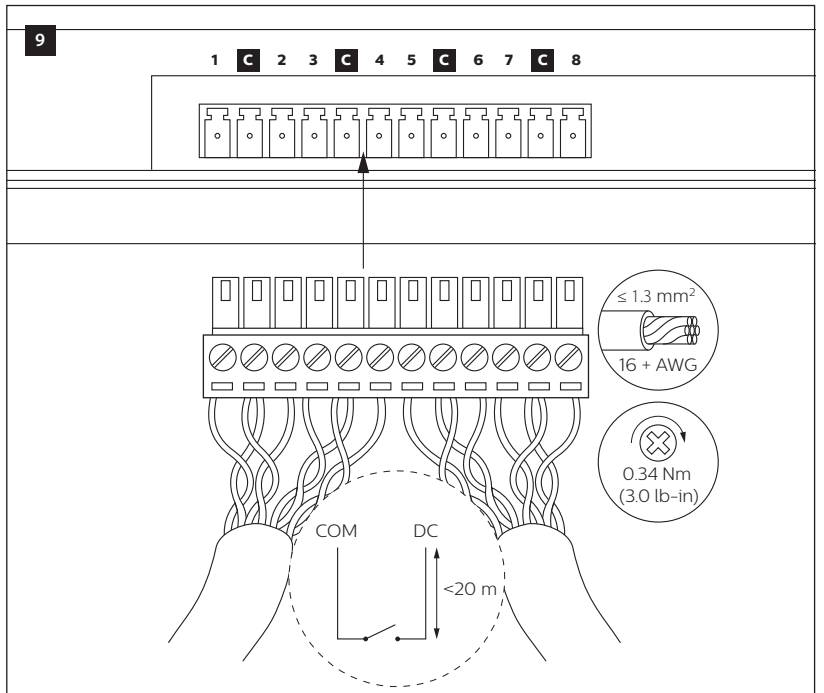

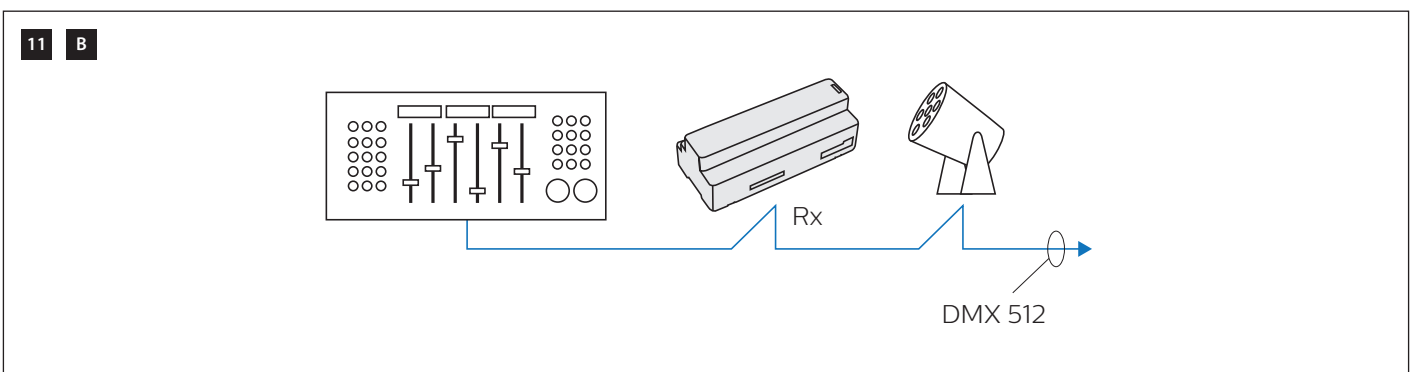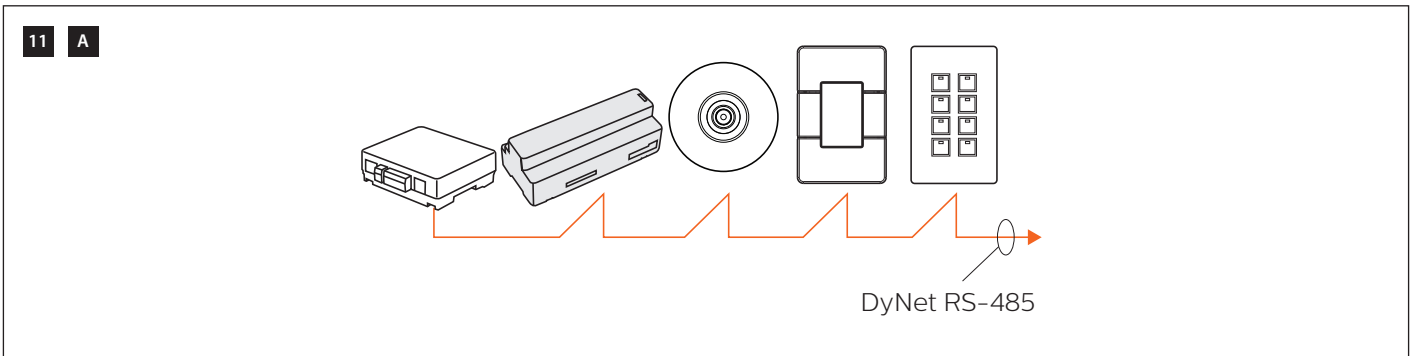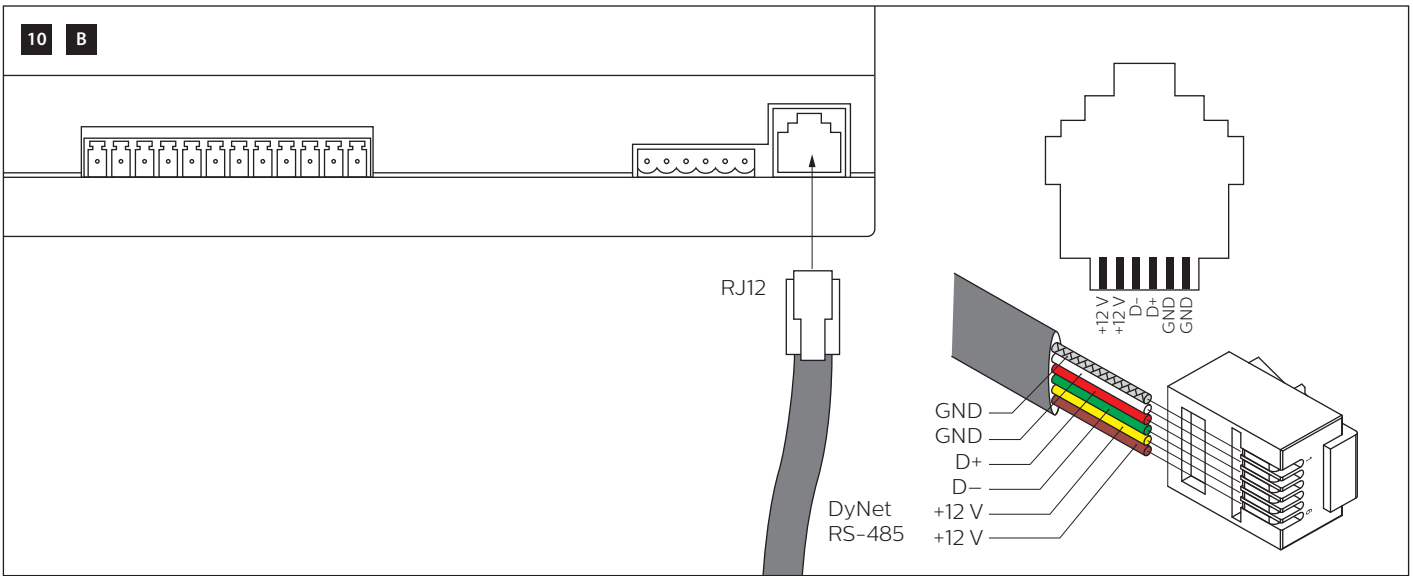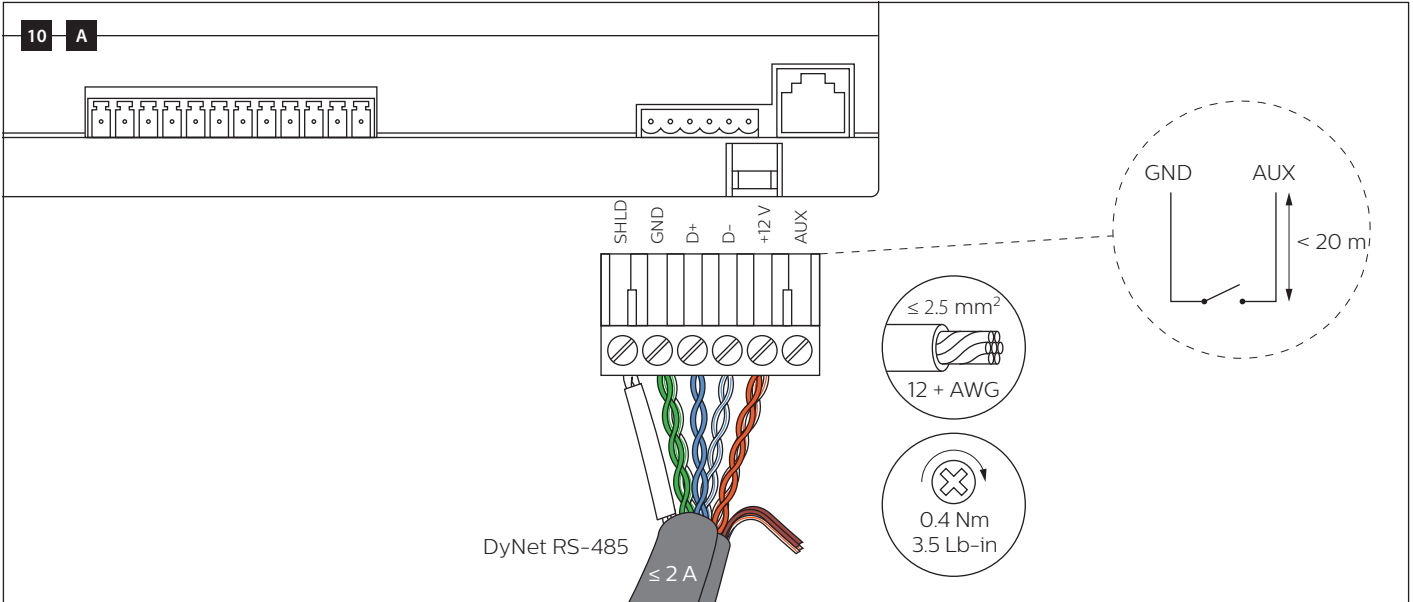

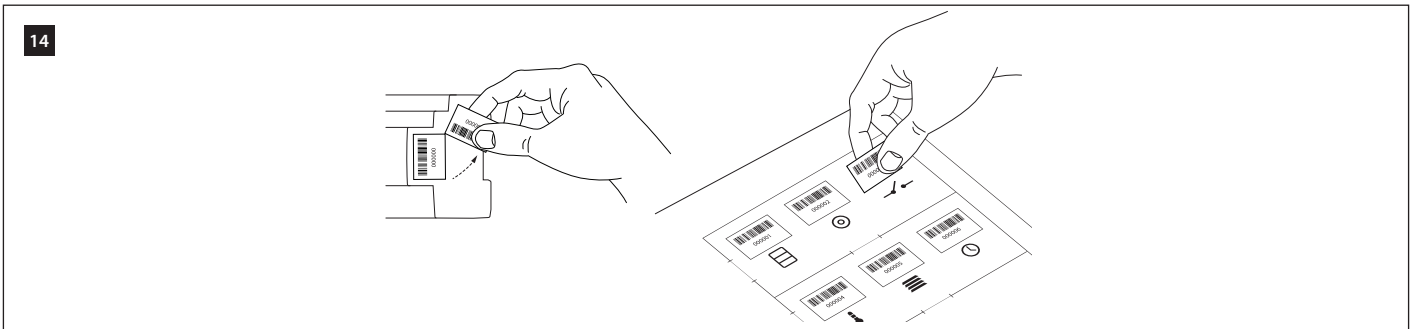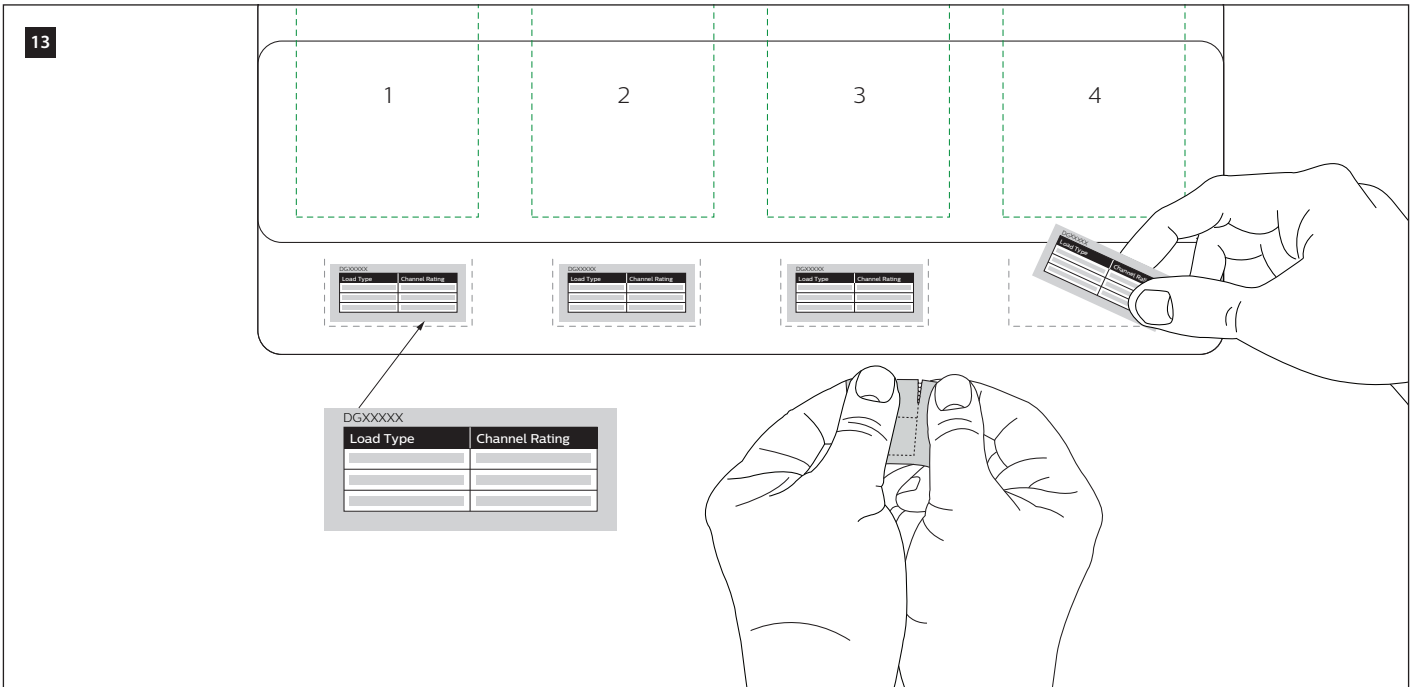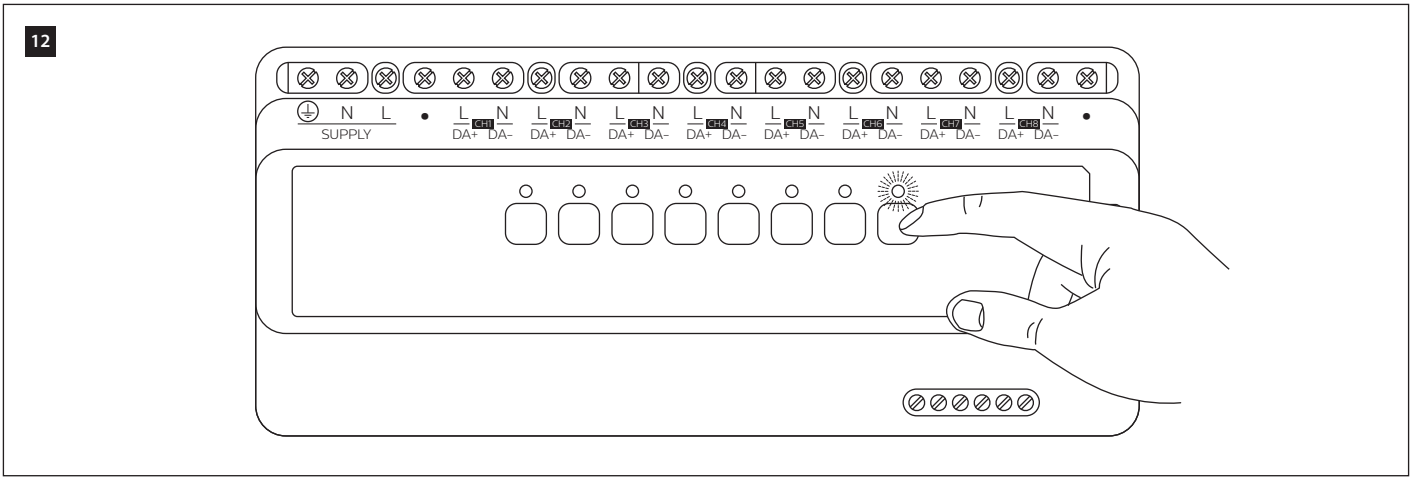

⚠ The manufacturer is not responsible for dimmable lamp selection. Each lamp/dimmer combination must be tested for compatibility prior to installation.

⚠ **Federal Communications Commission (FCC) Compliance Notice: Radio Frequency Notice** – This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures: Reorient or relocate the receiving antenna. Increase the separation between the equipment and receiver. Connect the equipment into an outlet on a circuit different from that to which the receiver is connected. Consult the dealer or an experienced radio/TV technician for help. Any modifications not approved by the manufacturer of this device could void the user's authority to operate this device.

⚠ This Class B digital apparatus complies with Canadian ICES-003: CAN ICES-3(B)/NMB-3(B). Cet appareil numérique de la classe B est conforme à la norme NMB-003 du Canada: CAN ICES-3(B)/NMB-3(B).

⚠ Installation of a home and building automation and control system shall comply with HD 60364-4-41. The temperature limits and current-carrying capacities for the communication wires specified in HD 384.5.523 shall not be exceeded.

